

Tested Light Source - 1_PHOT_NINETY-NINE-2350lmChip-4000K-21Deg-HoneycombLouvre_2303

Laboratory and Equipment

Laboratory Owner and Location

Goniospectrometer System and Type

Spectrometer Manufacturer and Model

Factorylux, Greenhill Mills, Hebden Bridge, HX7 5QF, UK

BaseSpion – Type C, horizontal

Ibsen Photonics, Denmark – Freedom VIS (Custom Viso)

Measurement Conditions

Number of C-planes and Resolution

γ (gamma)-Resolution

Test Distance

Input Power, Power and Displ. Factors

Input RMS Voltage and Current

Frequency of Input Power

32 planes – 11.25°

1°

1.50 m

16.0 W – PF 0.98 – DPF 0.98

240 V – 0.068 A

50.1 Hz

Main Light Measurement Results

Output

Efficiency

Peak Intensity and Beam Angle

Color Rendering Index


1249 lm

78 lm/W

7069 cd – 19.8°

CRI 92.8

Light Intensity Distribution

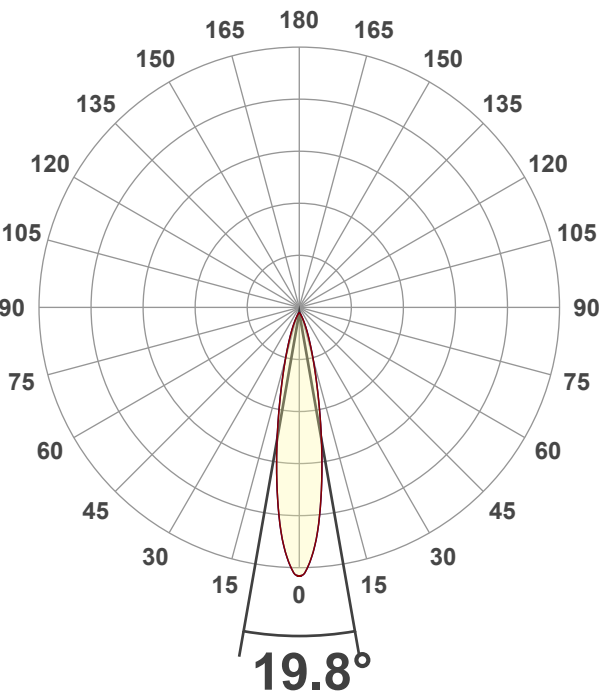


Goniophotometry Report

1_PHOT_NINETY-NINE-2350lmChip-4000K-21Deg-HoneycombLouvre_2303
www.factorylux.com



Luminous Intensity diagram

Unit: 0-100% of peak intensity

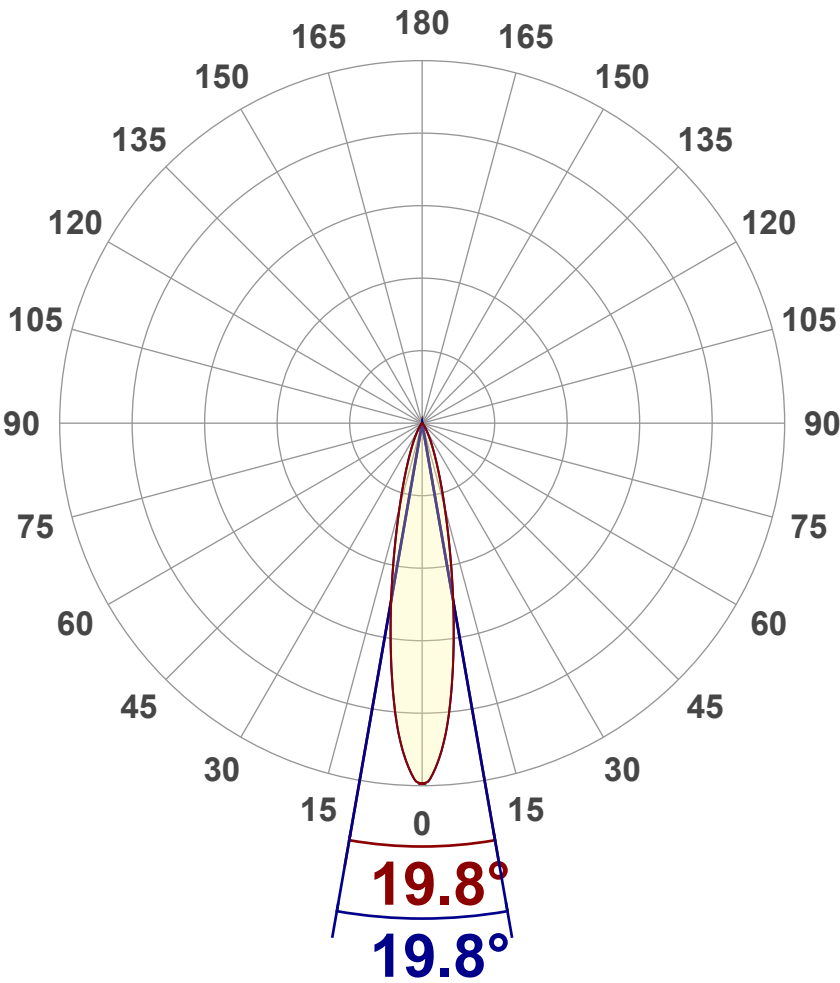

Main Values

Output (total Lumen)	1249 lm
Peak Intensity	7069 cd
Beam Angle (50%)	19.8°
Beam Angle (90%)	19.8°
Beam Angle (10%)	19.8°

Cut-off Angle

Average 2,5%	61°
--------------	-----

Field Angle

Average 10%	42.1°
-------------	-------


Intensity Ratio

In 120° cone	99.4%
In 90° cone	98.8%


C000-C180

C090-C270


Linear distribution diagram - Intensity (candela) vs γ-angle

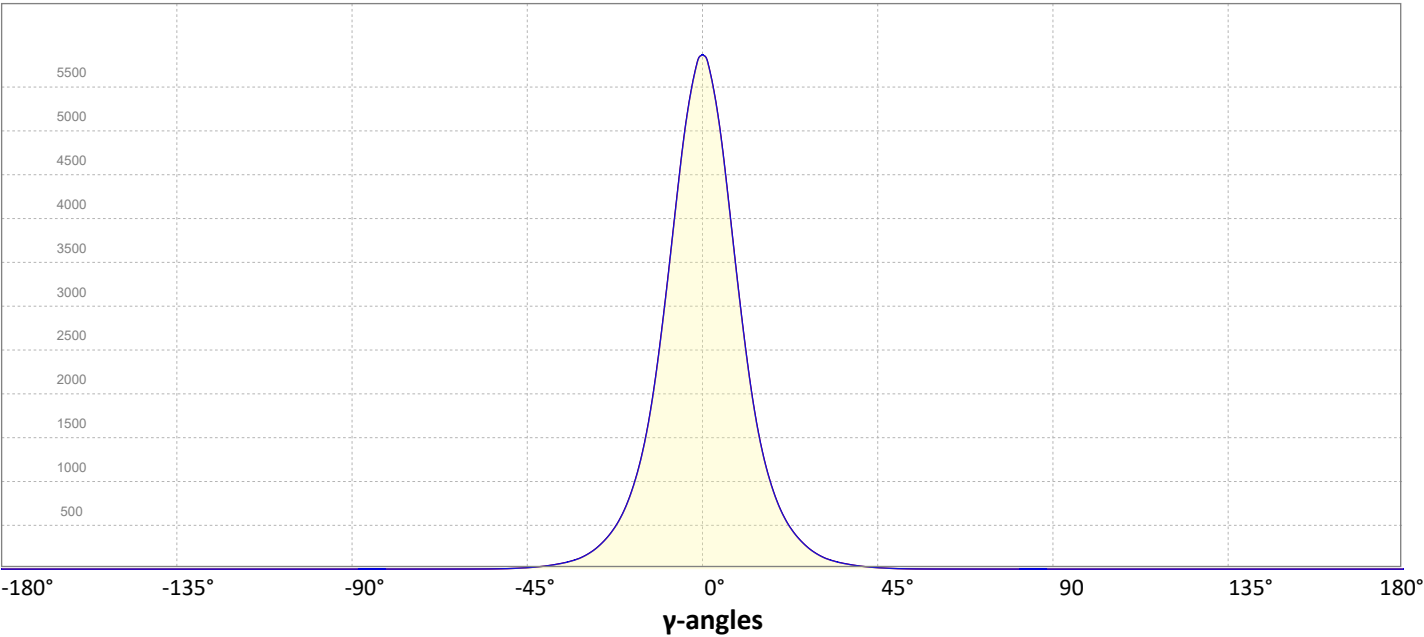

Iso-intensity Diagram (Iso-candela)

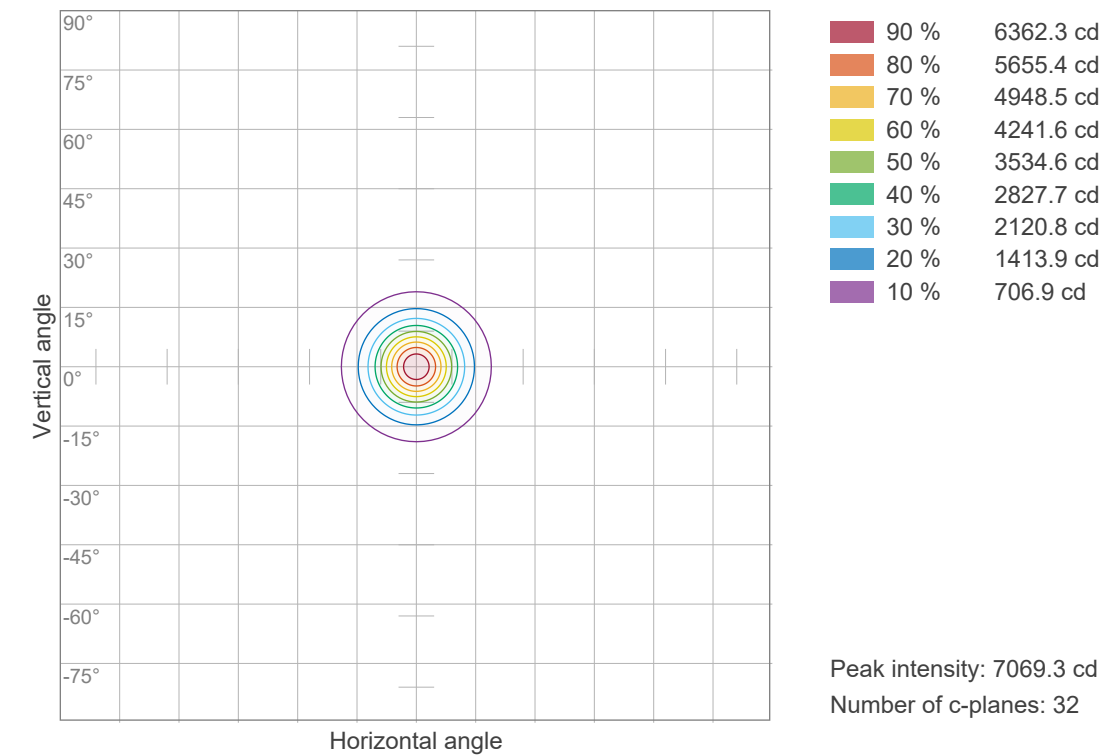

Iso-illuminance Diagram (Iso-lux)

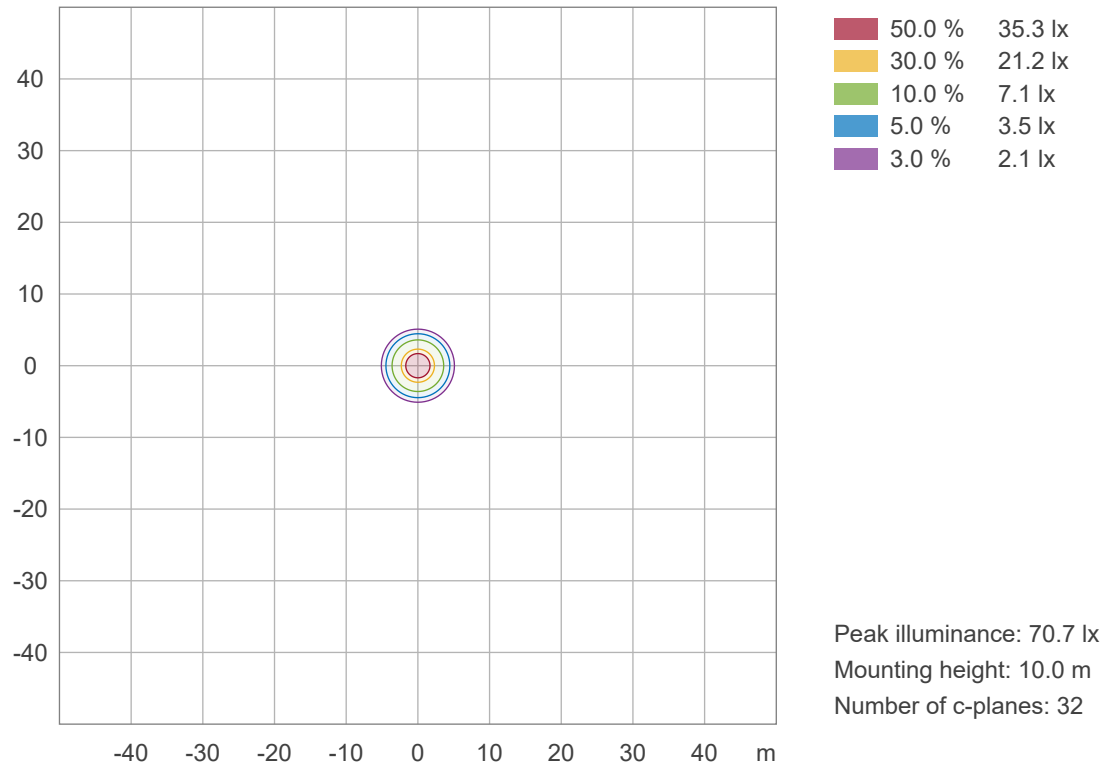


Goniophotometry Report

1_PHOT_NINETY-NINE-2350lmChip-4000K-21Deg-HoneycombLouvre_2303
www.factorylux.com



Beam Details

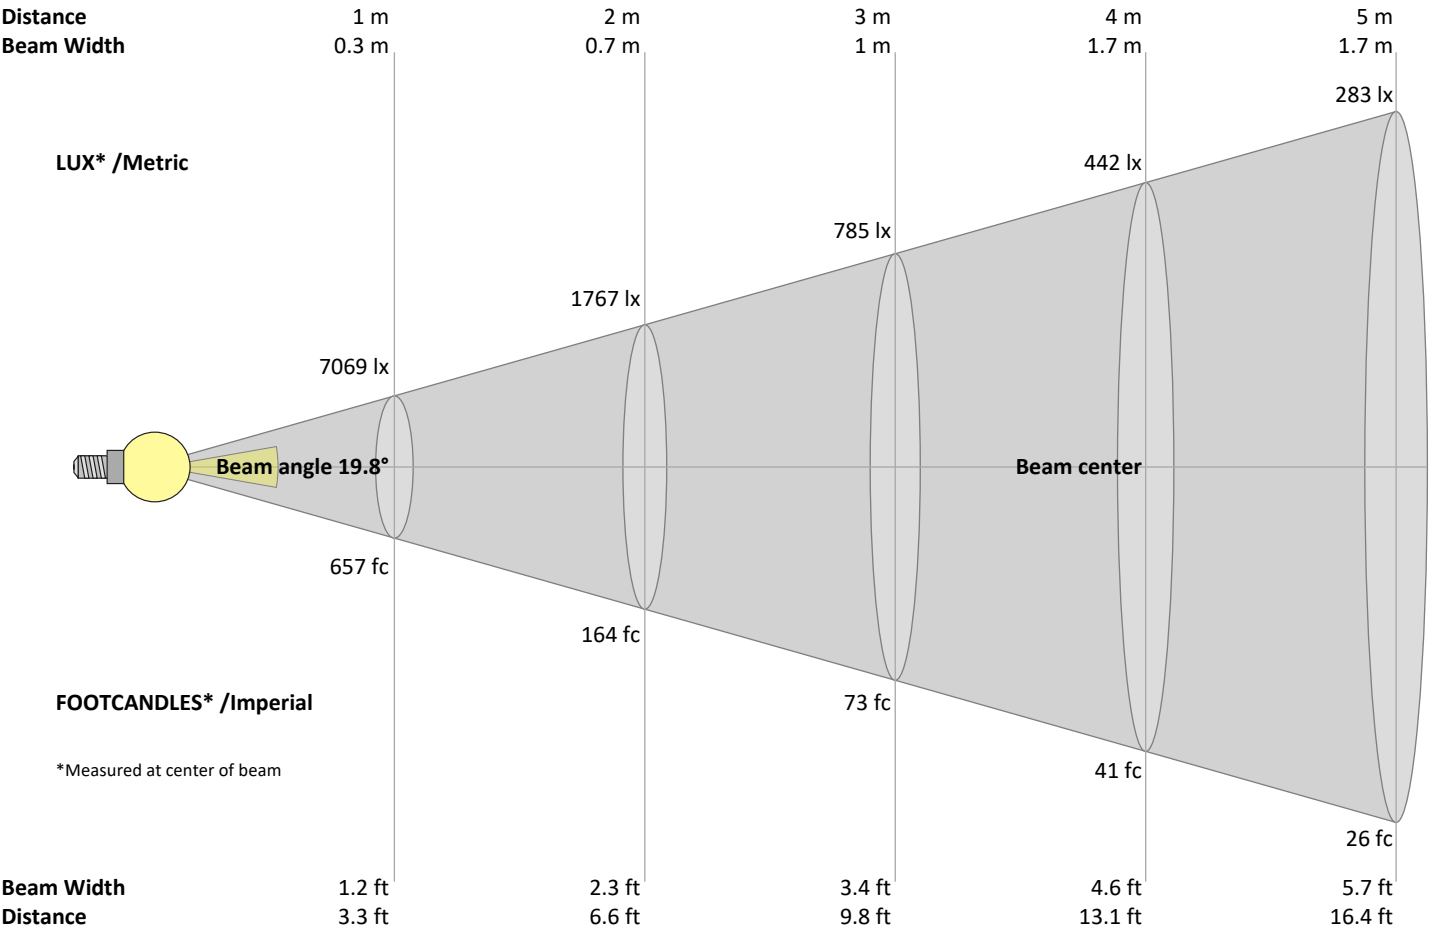

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3.3	6.6	9.8	13.1	16.4	19.7	23	26.2	29.5	32.8	36.1	39.4	42.7	45.9	49.2	52.5	55.8	59.1	62.3	65.6	ft
7069	1767	785	442	283	196	144	110	87	71	58	49	42	36	31	28	24	22	20	18	lux
656.8	164.2	73	41	26.3	18.2	13.4	10.3	8.1	6.6	5.4	4.6	3.9	3.4	2.9	2.6	2.3	2	1.8	1.6	fc

Intensities in 0° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
7069	6821	6226	5388	4430	3497	2663	1985	1478	1104	823	617	466	350	258	191	141	107	83	62	cd
100%	96%	88%	76%	63%	49%	38%	28%	21%	16%	12%	9%	7%	5%	4%	3%	2%	2%	1%	1%	of 0°val

Intensities in 90° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
7069	6821	6226	5388	4430	3497	2663	1985	1478	1104	823	617	466	350	258	191	141	107	83	62	cd
100%	96%	88%	76%	63%	49%	38%	28%	21%	16%	12%	9%	7%	5%	4%	3%	2%	2%	1%	1%	of 0°val

Intensities in 180° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
7069	6821	6226	5388	4430	3497	2663	1985	1478	1104	823	617	466	350	258	191	141	107	83	62	cd
100%	96%	88%	76%	63%	49%	38%	28%	21%	16%	12%	9%	7%	5%	4%	3%	2%	2%	1%	1%	of 0°val

Intensities in 270° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
7069	6821	6226	5388	4430	3497	2663	1985	1478	1104	823	617	466	350	258	191	141	107	83	62	cd
100%	96%	88%	76%	63%	49%	38%	28%	21%	16%	12%	9%	7%	5%	4%	3%	2%	2%	1%	1%	of 0°val

Goniophotometry Report

1_PHOT_NINETY-NINE-2350lmChip-4000K-21Deg-HoneycombLouvre_2303
www.factorylux.com



Light Planning – UGR table

Uncorrected, comprehensive UGR table according to 117-1995

Reflectances											
p Ceiling		70	70	50	50	30	70	70	50	50	30
p Walls		50	30	50	30	30	50	30	50	30	30
p Floor		20	20	20	20	20	20	20	20	20	20
Room size											
H = mounting height above eye level		Viewed Crosswise					Viewed Endwise				
X	Y	(Viewing direction orthogonal to lamp length axis)					(Viewing direction parallel to lamp length axis)				
2H	2H	10.6	11.0	10.7	11.2	11.4	10.6	11.0	10.7	11.2	11.4
	3H	10.4	10.9	10.7	11.1	11.3	10.4	10.9	10.7	11.1	11.3
	4H	10.3	10.9	10.7	11.1	11.3	10.3	10.9	10.7	11.1	11.3
	6H	10.4	10.8	10.7	11.1	11.5	10.4	10.8	10.7	11.1	11.5
	8H	10.4	10.8	10.7	11.2	11.5	10.4	10.8	10.7	11.2	11.5
	12H	10.4	10.9	10.8	11.2	11.6	10.4	10.9	10.8	11.2	11.6
4H	2H	10.3	10.8	10.7	11.0	11.3	10.3	10.8	10.7	11.0	11.3
	3H	10.2	10.6	10.6	11.0	11.4	10.2	10.6	10.6	11.0	11.4
	4H	10.2	10.5	10.6	11.0	11.5	10.2	10.5	10.6	11.0	11.5
	6H	10.2	10.6	10.7	11.0	11.3	10.2	10.6	10.7	11.0	11.3
	8H	10.2	10.7	10.8	11.0	11.4	10.2	10.7	10.8	11.0	11.4
	12H	10.3	10.7	10.8	11.1	11.5	10.3	10.7	10.8	11.1	11.5
8H	4H	10.1	10.5	10.6	10.8	11.2	10.1	10.5	10.6	10.8	11.2
	6H	10.2	10.4	10.7	10.9	11.4	10.2	10.4	10.7	10.9	11.4
	8H	10.3	10.5	10.9	11.1	11.7	10.3	10.5	10.9	11.1	11.7
	12H	10.5	10.7	11.1	11.2	11.8	10.5	10.7	11.1	11.2	11.8
12H	4H	10.0	10.3	10.5	10.7	11.2	10.0	10.3	10.5	10.7	11.2
	6H	10.2	10.4	10.7	10.9	11.5	10.2	10.4	10.7	10.9	11.5
	8H	10.3	10.5	10.9	11.0	11.6	10.3	10.5	10.9	11.0	11.6

Variations with the observer position for the luminaire spacings, S:

S = 1.0H	4.2 / -4.0	4.2 / -4.0
S = 1.5H	6.7 / -4.3	6.7 / -4.3
S = 2.0H	8.6 / -4.6	8.6 / -4.6

Coefficients of Utilization

Ceiling reflectance	80			70			50			30			10			0		
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR		(RCR: Room Cavity Ratio)			Room Values are expressed as percentage of Lumen delivered to the task surface													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	113	111	109	113	111	109	107	107	105	104	103	102	101	99	99	98	96
2	111	107	104	102	109	106	103	101	103	100	99	100	98	96	97	96	94	93
3	108	103	99	96	106	102	98	96	99	96	94	97	94	93	95	93	91	90
4	104	99	95	92	103	98	94	91	96	93	90	94	91	89	92	90	88	87
5	101	95	91	88	100	94	90	88	93	89	87	91	88	86	90	87	85	84
6	98	92	88	85	97	91	87	84	90	86	84	89	86	83	87	85	83	82
7	95	89	85	82	94	88	84	82	87	84	81	86	83	81	85	83	80	79
8	93	86	82	79	92	86	82	79	85	81	79	84	81	79	83	80	78	77
9	90	84	80	77	90	83	79	77	83	79	77	82	79	76	81	78	76	75
10	88	81	77	75	87	81	77	75	80	77	75	80	77	74	79	76	74	73

Goniophotometry Report


1_PHOT_NINETY-NINE-2350lmChip-4000K-21Deg-HoneycombLouvre_2303
www.factorylux.com



Luminaire budgetary diagram

Uncorrected, comprehensive UGR table according to 117-1995

LAMPS (number of lamps)

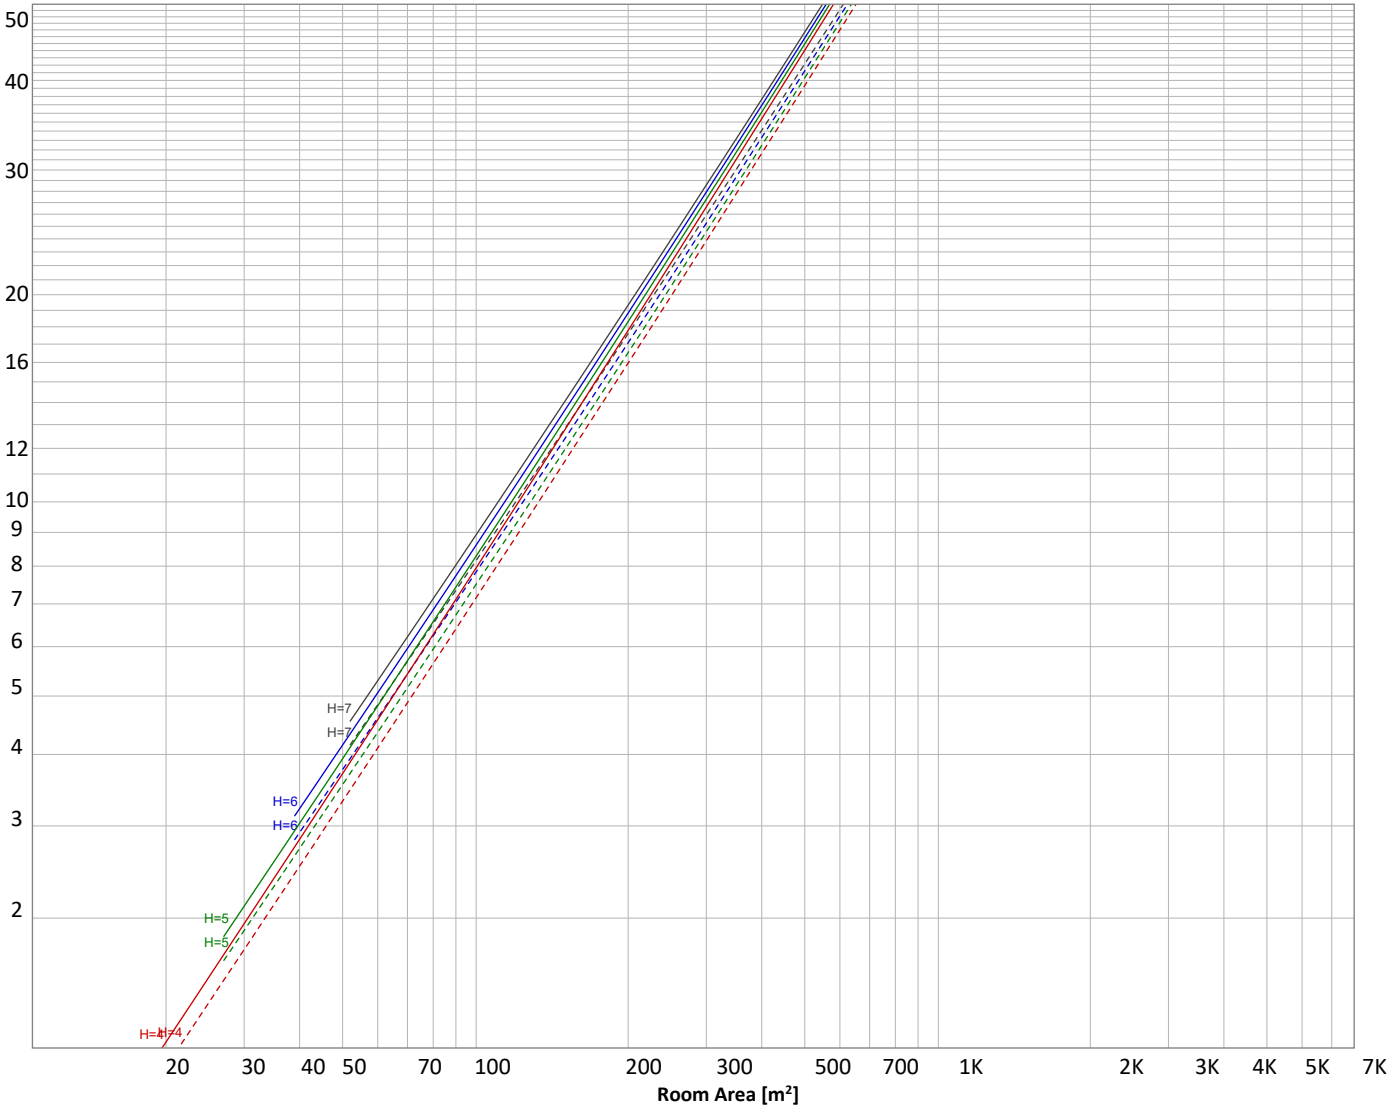

Conditions

H = Room height	Flux = 1249 lm	p(%)		
H _{down} = Lamp distance from ceiling =	0.00 m	Line type	Ceiling reflectance	Wall reflectance
H _{work} = Work area height from floor =	0.00 m	-----	70	50
E _{work} = Average lux on work area =	100 lx	—————	50	30
				Floor reflectance
				20

Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
478 lm	488 lm	193 lm	62.4 lm	17.0 lm	3.04 lm	1.47 lm	1.20 lm	0.940 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
0.584 lm	0.566 lm	0.531 lm	0.480 lm	0.415 lm	0.336 lm	0.248 lm	0.152 lm	0.051 lm

Outdoor Light Planning

Lumen per Zone

Zone (γ)	Lumen	% Total
0-10°	478 lm	38.3%
10-20°	488 lm	39.1%
20-30°	193 lm	15.5%
30-40°	62 lm	5.0%
40-50°	17 lm	1.4%
50-60°	3 lm	0.2%
60-70°	1 lm	0.1%
70-80°	1 lm	0.1%
80-90°	1 lm	0.1%
90-100°	1 lm	0.0%
100-110°	1 lm	0.0%
110-120°	1 lm	0.0%
120-130°	0 lm	0.0%
130-140°	0 lm	0.0%
140-150°	0 lm	0.0%
150-160°	0 lm	0.0%
160-170°	0 lm	0.0%
170-180°	0 lm	0.0%
Total	1249 lm	100.0%

Intensity peaks

Max intensity	7069 cd
Intensity, 90°	1 cd
Intensity, 0°	7069 cd

Zonal Lumen summary


Zone (γ)	Lumen	% Total
0-30°	1160 lm	92.8%
0-40°	1222 lm	97.8%
0-60°	1242 lm	99.4%
60-90°	4 lm	0.3%
70-100°	3 lm	0.2%
90-120°	2 lm	0.1%
0-90°	1246 lm	99.7%
90-180°	3 lm	0.3%
0-180°	1249 lm	100.0%

BUG rating

	Lumen	% Total
Forward light		
Low(0-30°)	581 lm	46.5%
Medium(30-60°)	41 lm	3.3%
High(60-80°)	1 lm	0.1%
Very high(80-90°)	0 lm	0.0%
Back light		
Low(0-30°)	581 lm	46.5%
Medium(30-60°)	41 lm	3.3%
High(60-80°)	1 lm	0.1%
Very high(80-90°)	0 lm	0.0%
Uplight		
Low(90-100°)	0 lm	0.0%
High(100-180°)	0 lm	0.0%

IESNA TM-15-07
Luminaire Classification System
For Outdoor Luminaires

BUG rating B2 U1 G0

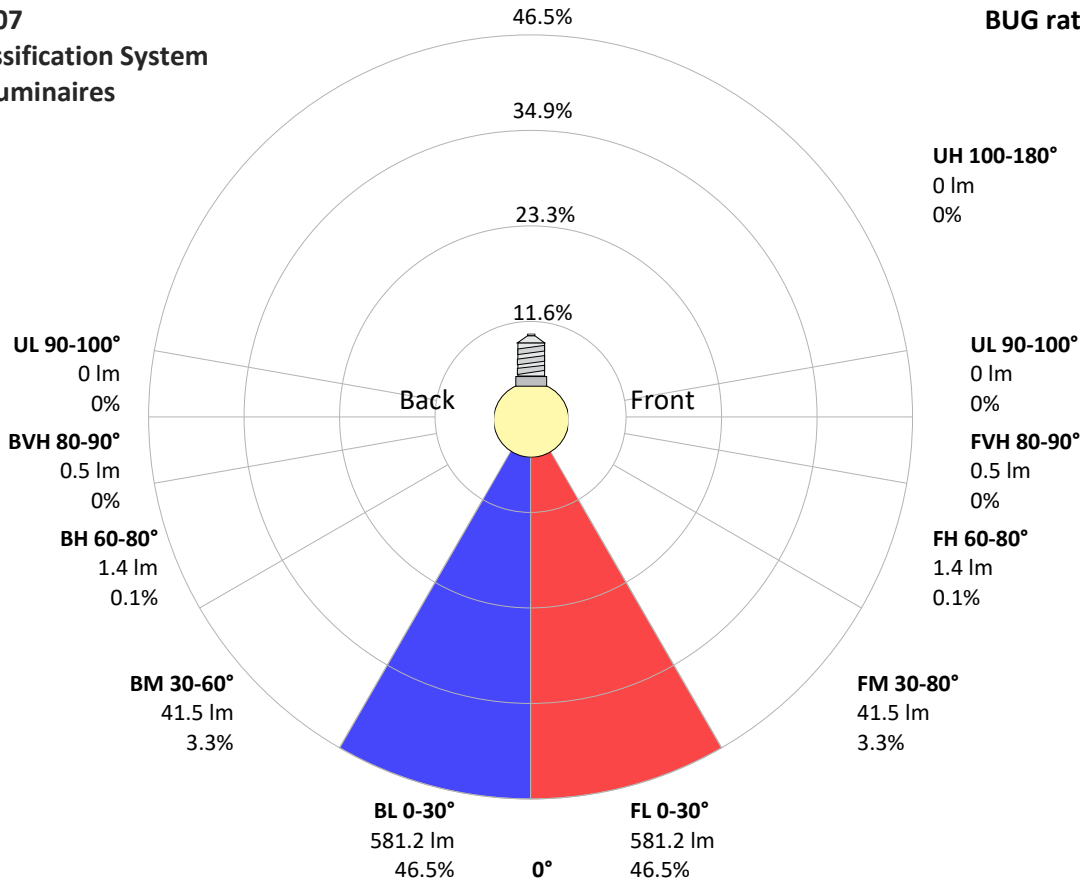

Goniophotometry Report

1_PHOT_NINETY-NINE-2350lmChip-4000K-21Deg-HoneycombLouvre_2303
www.factorylux.com



Power Details


Input Power

Power feed to light source	16.0 W
Frequency of input power	50.1 Hz
RMS Input voltage feed, V_{RMS}	240 V
RMS Input current feed, I_{RMS}	0.068 A
Volt-Ampere or apparent power = $V_{RMS} \cdot I_{RMS}$	16.3 VA
Displacement factor of AC power feed	0.98
Power factor of AC current feed	0.98
Total harmonic distortion of the current	6.37%
Total harmonic distortion of the voltage	0.99%

Efficiency

Radiated power efficiency	28.6%
<div><div></div></div>	
Lumen efficiency	78 lm/W
<div><div></div></div>	


Input Power Curve

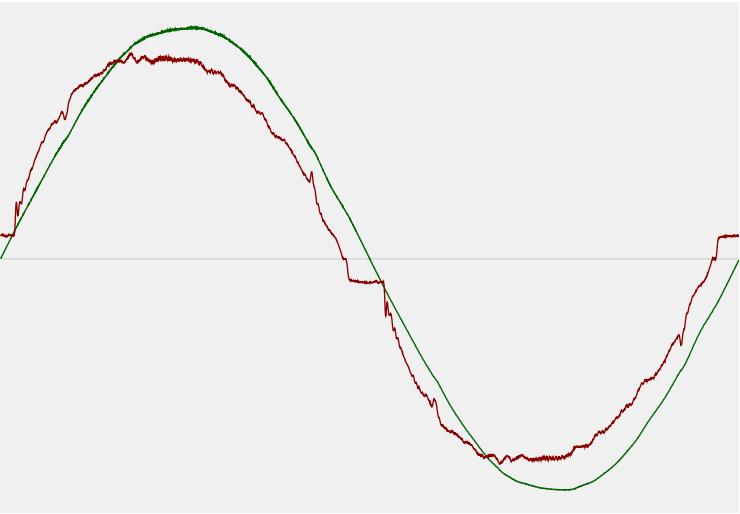

Color Measurements

Correlated Color Temperature	CCT = 4000 K
Color Rendering TM30-18	R _f 88.9 – R _g 98.5
Color Shift, CIE duv	Duv ±0.0003

Spectral distribution

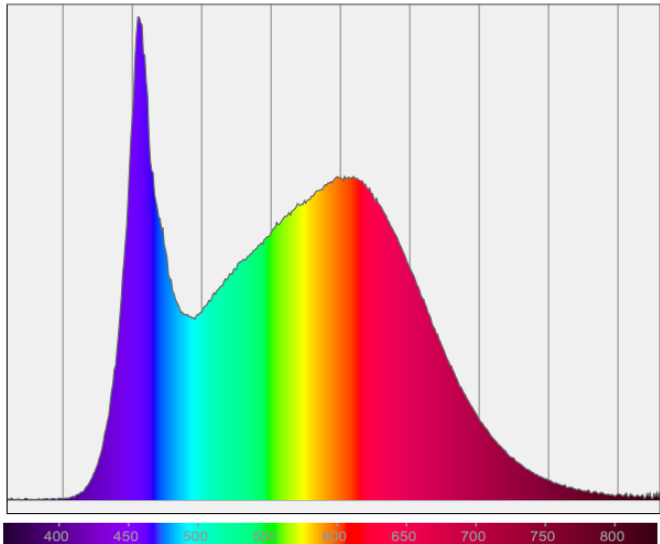

Color details


Correlated Color Temperature	CCT = 4000 K	Color coordinates CIE 1931	(x;y) = (0.381;0.377)
Color Rendering Index	CRI 92.6	Color coordinate CIEs 1960	(u;v) = (0.225;0.334)
Color Rendering Index, R9 (red component)	R9 = 72.2	Color deviation from BBL	Duv = ±0.0003
Color Rendering TM30-18	R _f 88.9 – R _g 98.5	Color coordinate CIEs 1976 (CIELUV)	(u';v') = (0.225;0.225)
Color Quality Scale	CQS = 88.9		

Goniophotometry Report


1_PHOT_NINETY-NINE-2350lmChip-4000K-21Deg-HoneycombLouvre_2303
www.factorylux.com




CIE 1931

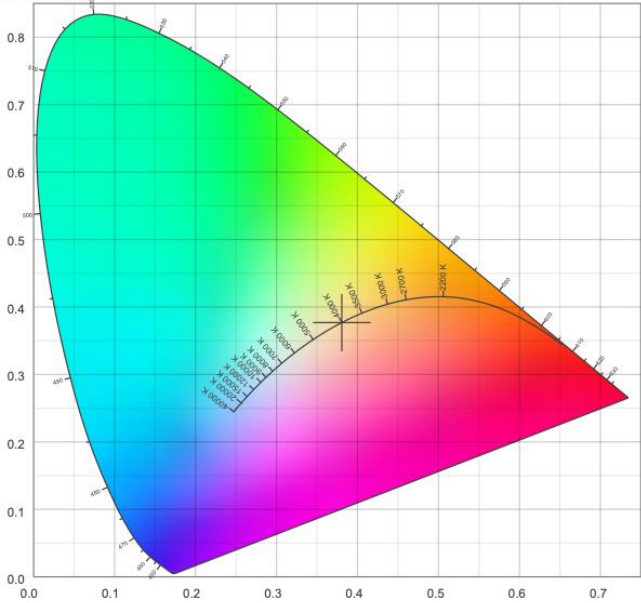

CIE 1931 – zoomed on Planckian locus

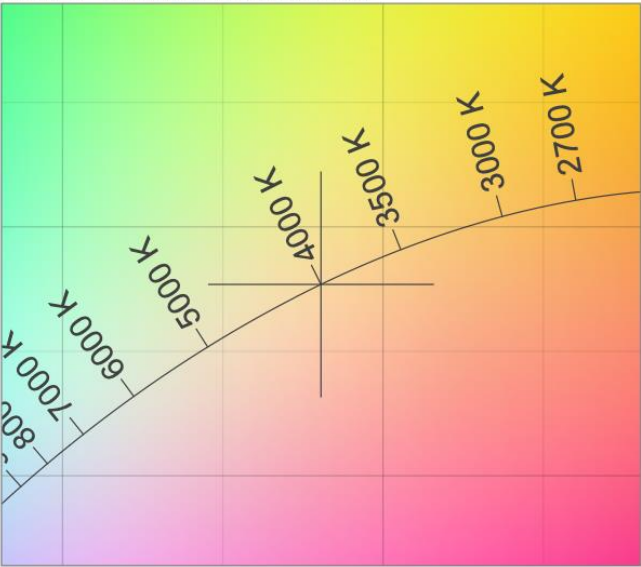


Color Rendering Index per reference color (CIE 1995)

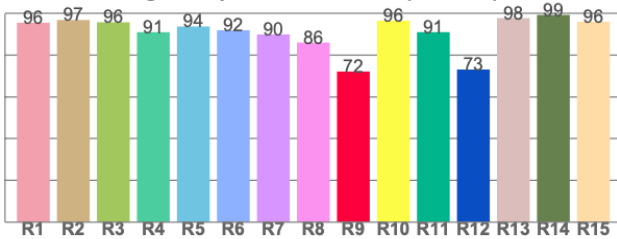

CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
95.5	96.8	95.7	91.0	93.7	91.9	89.9	86.0	72.2	96.4	91.0	73.1	97.7	99.2	96.0


TM30-18 Rf-values per hue bin

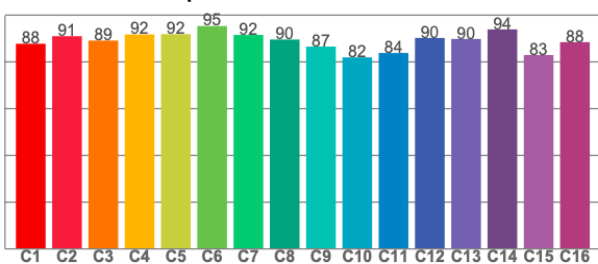


TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
87.8	91.0	89.1	91.7	91.9	95.3	91.5	89.6	86.6	81.9	83.8	90.3	89.8	93.9	83.0	88.4

Spectral power distribution (SPD) / W/nm – 0-100%

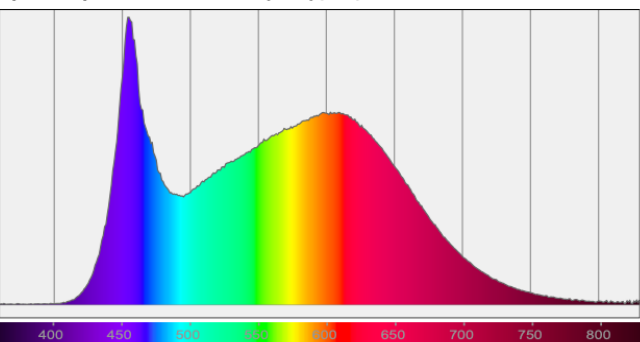

Color Quality Scale by reference color

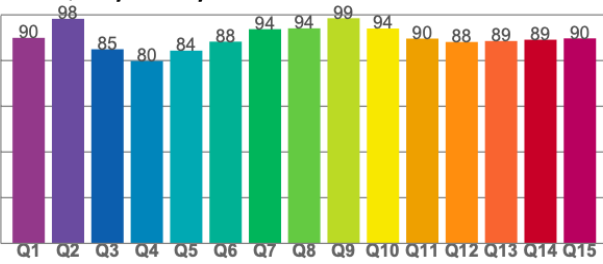

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
89.9	98.3	84.9	79.8	84.3	88.3	93.7	94.1	98.5	94.0	89.6	88.1	88.6	89.1	89.7