

Tested Light Source - 1_PHOT_REFLEKTER-L-4300lmChip-3000K-58Deg-ConcentricLouvre_2303

Laboratory and Equipment

Laboratory Owner and Location

Goniospectrometer System and Type

Spectrometer Manufacturer and Model

Factorylux, Greenhill Mills, Hebden Bridge, HX7 5QF, UK

BaseSpion – Type C, horizontal

Ibsen Photonics, Denmark – Freedom VIS (Custom Viso)

Measurement Conditions

Number of C-planes and Resolution

γ (gamma)-Resolution

Test Distance

Input Power, Power and Displ. Factors

Input RMS Voltage and Current

Frequency of Input Power

32 planes – 11.25°

1.5°

3.00 m

41.4 W – PF 0.97 – DPF 0.97

238 V – 0.180 A

50 Hz

Main Light Measurement Results

Output

Efficiency

Peak Intensity and Beam Angle

Color Rendering Index


2653 lm

64 lm/W

4144 cd – 44.2°

CRI 92.7

Light Intensity Distribution

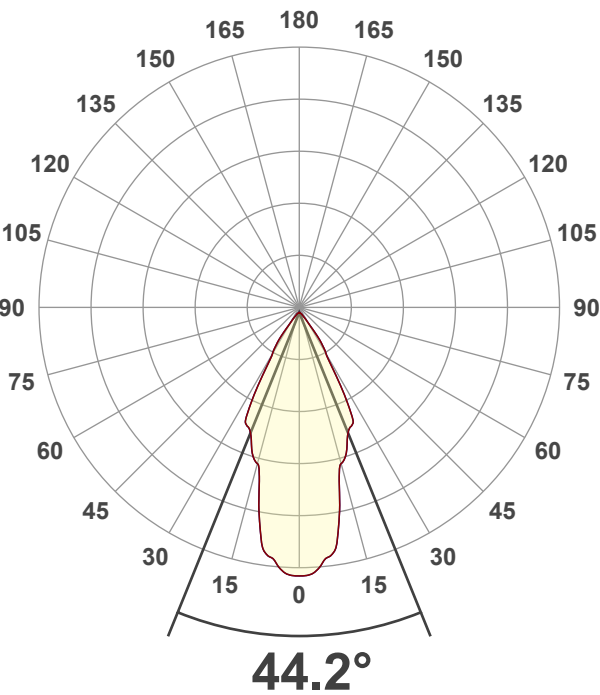


Goniophotometry Report

1_PHOT_REFLEKTER-L-4300lmChip-3000K-58Deg-ConcentricLouvre_2303
www.factorylux.com



Luminous Intensity diagram

Unit: 0-100% of peak intensity

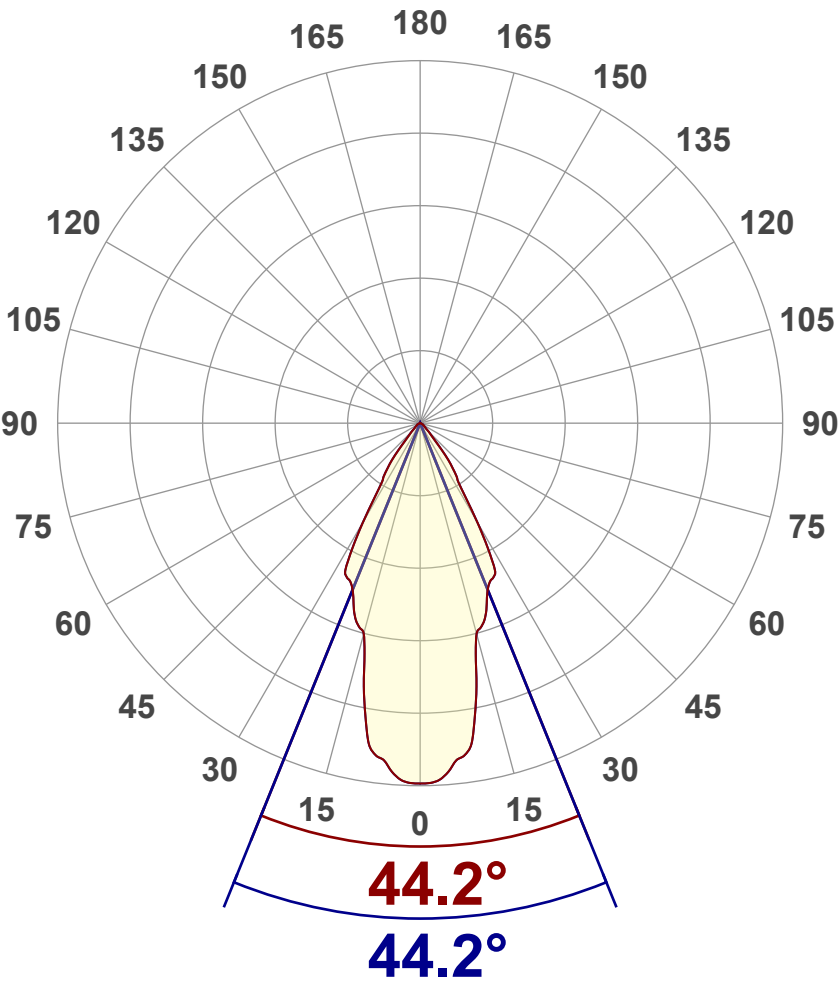

Main Values

Output (total Lumen)	2653 lm
Peak Intensity	4144 cd
Beam Angle (50%)	44.2°
Beam Angle (90%)	44.2°
Beam Angle (10%)	44.2°

Cut-off Angle

Average 2,5%	93.6°
--------------	-------

Field Angle

Average 10%	77.4°
-------------	-------


Intensity Ratio

In 120° cone	97.5%
In 90° cone	94.1%

C000-C180

C090-C270

Linear distribution diagram - Intensity (candela) vs γ-angle

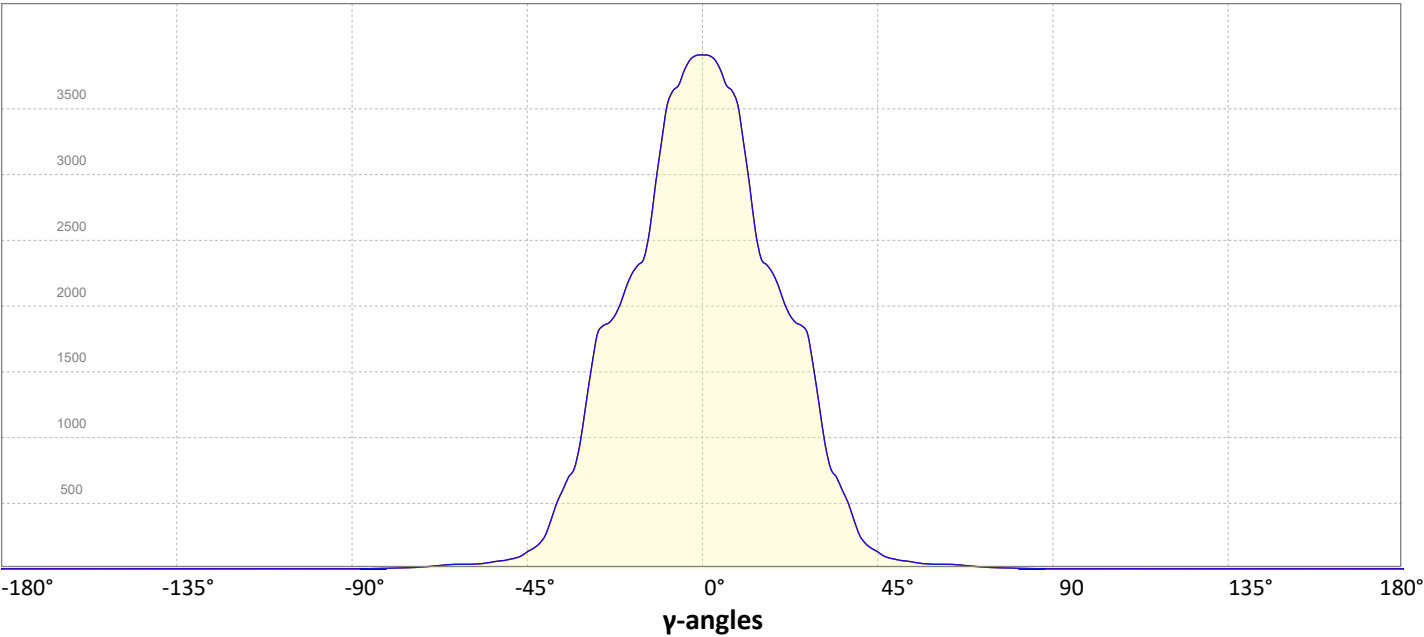


Goniophotometry Report

1_PHOT_REFLEKTER-L-4300lmChip-3000K-58Deg-ConcentricLouvre_2303
www.factorylux.com




Iso-intensity Diagram (Iso-candela)

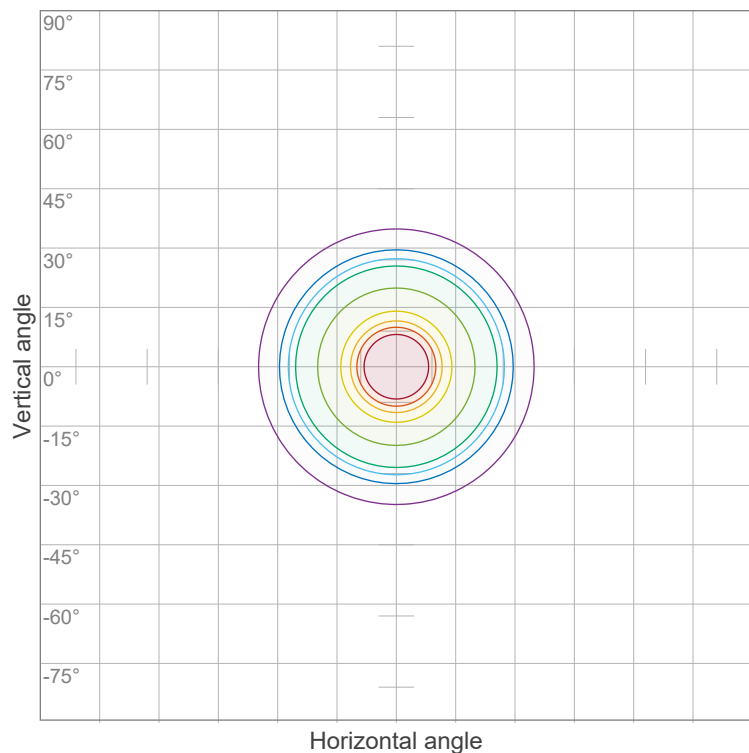

90 %	3729.5 cd
80 %	3315.1 cd
70 %	2900.7 cd
60 %	2486.3 cd
50 %	2071.9 cd
40 %	1657.5 cd
30 %	1243.2 cd
20 %	828.8 cd
10 %	414.4 cd

Peak intensity: 4143.8 cd
Number of c-planes: 32

Iso-illuminance Diagram (Iso-lux)

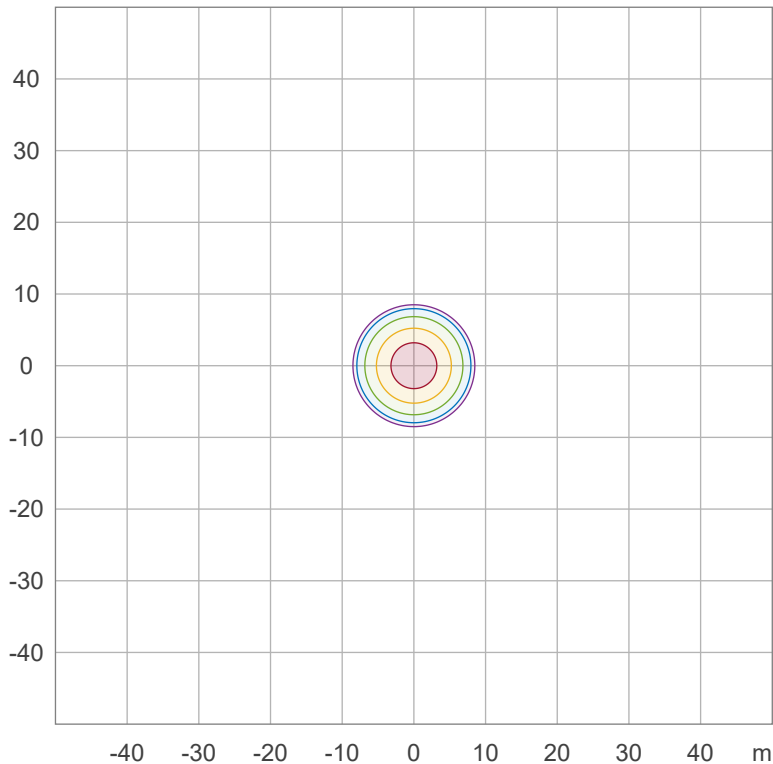

50.0 %	20.7 lx
30.0 %	12.4 lx
10.0 %	4.1 lx
5.0 %	2.1 lx
3.0 %	1.2 lx


Peak illuminance: 41.4 lx
Mounting height: 10.0 m
Number of c-planes: 32

Goniophotometry Report

1_PHOT_REFLEKTER-L-4300lmChip-3000K-58Deg-ConcentricLouvre_2303
www.factorylux.com



Beam Details

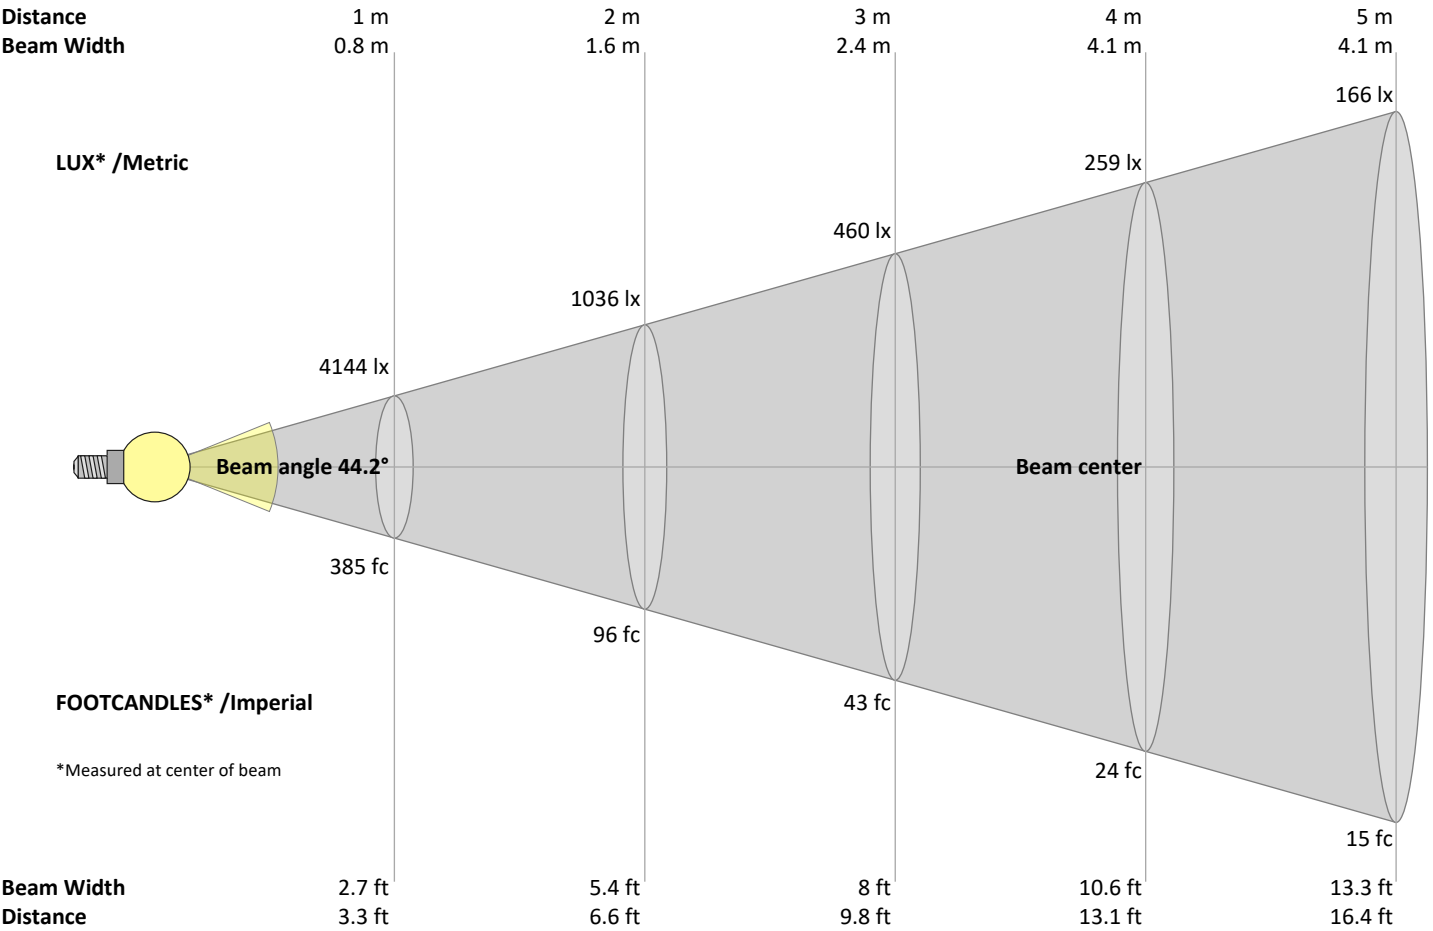

Beam intensities from 1 – 20 m

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	m
3.3	6.6	9.8	13.1	16.4	19.7	23	26.2	29.5	32.8	36.1	39.4	42.7	45.9	49.2	52.5	55.8	59.1	62.3	65.6	ft
4144	1036	460	259	166	115	85	65	51	41	34	29	25	21	18	16	14	13	11	10	lux
385	96.2	42.8	24.1	15.4	10.7	7.9	6	4.8	3.8	3.2	2.7	2.3	2	1.7	1.5	1.3	1.2	1.1	1	fc

Intensities in 0° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
4144	4132	4058	3910	3822	3547	3114	2662	2470	2386	2236	2077	1986	1939	1713	1314	936	760	629	478	cd
100%	100%	98%	94%	92%	86%	75%	64%	60%	58%	54%	50%	48%	47%	41%	32%	23%	18%	15%	12%	of 0°val

Intensities in 90° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
4144	4132	4058	3910	3822	3547	3114	2662	2470	2386	2236	2077	1986	1939	1713	1314	936	760	629	478	cd
100%	100%	98%	94%	92%	86%	75%	64%	60%	58%	54%	50%	48%	47%	41%	32%	23%	18%	15%	12%	of 0°val

Intensities in 180° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
4144	4132	4058	3910	3822	3547	3114	2662	2470	2386	2236	2077	1986	1939	1713	1314	936	760	629	478	cd
100%	100%	98%	94%	92%	86%	75%	64%	60%	58%	54%	50%	48%	47%	41%	32%	23%	18%	15%	12%	of 0°val

Intensities in 270° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°	γ
4144	4132	4058	3910	3822	3547	3114	2662	2470	2386	2236	2077	1986	1939	1713	1314	936	760	629	478	cd
100%	100%	98%	94%	92%	86%	75%	64%	60%	58%	54%	50%	48%	47%	41%	32%	23%	18%	15%	12%	of 0°val

Goniophotometry Report

1_PHOT_REFLEKTER-L-4300lmChip-3000K-58Deg-ConcentricLouvre_2303

www.factorylux.com



Light Planning – UGR table


Uncorrected, comprehensive UGR table according to 117-1995

Reflectances											
	p Ceiling	70	70	50	50	30	70	70	50	50	30
	p Walls	50	30	50	30	30	50	30	50	30	30
	p Floor	20	20	20	20	20	20	20	20	20	20
Room size											
H = mounting height above eye level											
X	Y	Viewed Crosswise (Viewing direction orthogonal to lamp length axis)					Viewed Endwise (Viewing direction parallel to lamp length axis)				
2H	2H	21.2	21.8	21.3	22.1	22.3	21.2	21.8	21.3	22.1	22.3
	3H	21.2	21.9	21.6	22.1	22.3	21.2	21.9	21.6	22.1	22.3
	4H	21.2	21.9	21.6	22.1	22.4	21.2	21.9	21.6	22.1	22.4
	6H	21.2	21.8	21.5	22.1	22.5	21.2	21.8	21.5	22.1	22.5
	8H	21.2	21.8	21.5	22.1	22.5	21.2	21.8	21.5	22.1	22.5
	12H	21.2	21.7	21.5	22.1	22.5	21.2	21.7	21.5	22.1	22.5
4H	2H	21.0	21.7	21.4	22.0	22.2	21.0	21.7	21.4	22.0	22.2
	3H	21.2	21.8	21.6	22.2	22.6	21.2	21.8	21.6	22.2	22.6
	4H	21.2	21.7	21.6	22.1	22.7	21.2	21.7	21.6	22.1	22.7
	6H	21.2	21.8	21.7	22.1	22.4	21.2	21.8	21.7	22.1	22.4
	8H	21.2	21.7	21.7	22.0	22.4	21.2	21.7	21.7	22.0	22.4
	12H	21.1	21.5	21.6	22.0	22.4	21.1	21.5	21.6	22.0	22.4
8H	4H	21.1	21.6	21.6	22.0	22.3	21.1	21.6	21.6	22.0	22.3
	6H	21.2	21.5	21.7	22.0	22.5	21.2	21.5	21.7	22.0	22.5
	8H	21.2	21.5	21.7	22.0	22.6	21.2	21.5	21.7	22.0	22.6
	12H	21.2	21.4	21.8	21.9	22.5	21.2	21.4	21.8	21.9	22.5
12H	4H	21.1	21.5	21.6	21.9	22.3	21.1	21.5	21.6	21.9	22.3
	6H	21.2	21.5	21.7	22.0	22.6	21.2	21.5	21.7	22.0	22.6
	8H	21.2	21.4	21.8	21.9	22.5	21.2	21.4	21.8	21.9	22.5
Variations with the observer position for the luminaire spacings, S:											
S = 1.0H		4.0 / -3.7					4.0 / -3.7				
S = 1.5H		6.5 / -4.2					6.5 / -4.2				
S = 2.0H		8.4 / -4.7					8.4 / -4.7				

Coefficients of Utilization

Ceiling reflectance	80			70			50			30			10			0		
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR		(RCR: Room Cavity Ratio)			Room Values are expressed as percentage of Lumen delivered to the task surface													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	99
1	113	111	108	106	111	108	106	104	104	102	101	100	99	98	97	96	95	93
2	108	103	99	96	106	101	98	94	98	95	92	95	92	90	92	90	88	87
3	102	96	91	87	100	95	90	87	92	88	85	90	86	84	87	85	82	81
4	98	90	85	80	96	89	84	80	87	82	79	85	81	78	83	80	77	76
5	93	85	79	75	91	84	78	74	82	77	74	80	76	73	79	75	72	71
6	88	80	74	70	87	79	73	69	77	73	69	76	72	68	75	71	68	67
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63
8	80	71	65	61	79	71	65	61	70	65	61	68	64	61	67	63	60	59
9	77	68	62	58	76	67	62	58	66	61	58	65	61	57	64	60	57	56
10	74	64	59	55	73	64	58	55	63	58	55	62	58	54	61	57	54	53

Luminaire budgetary diagram
Uncorrected, comprehensive UGR table according to 117-1995
LAMPS (number of lamps)

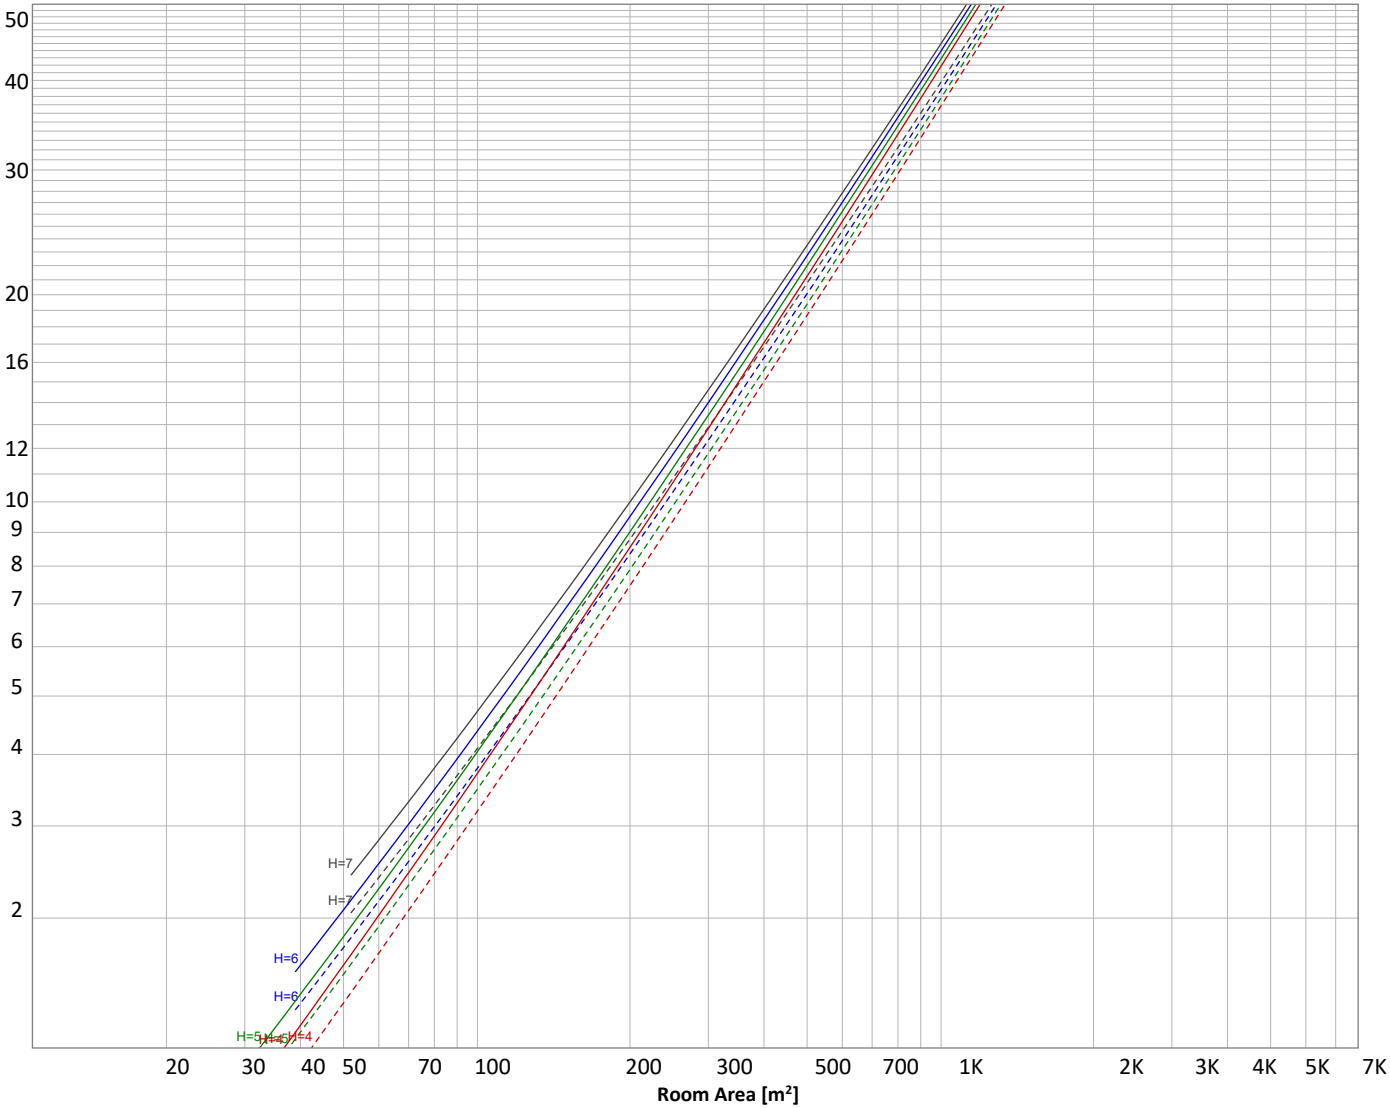

Conditions		ρ(%)			
H = Room height	Flux = 2653 lm	Line type	Ceiling reflectance	Wall reflectance	Floor reflectance
H _{down} = Lamp distance from ceiling =	0.00 m	-----	70	50	30
H _{work} = Work area height from floor =	0.00 m	—————	50	30	20
E _{work} = Average lux on work area =	100 lx				

Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
370 lm	745 lm	871 lm	439 lm	113 lm	47.7 lm	33.2 lm	13.9 lm	4.83 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
2.70 lm	2.62 lm	2.46 lm	2.22 lm	1.92 lm	1.56 lm	1.15 lm	0.703 lm	0.237 lm

Outdoor Light Planning

Lumen per Zone

Zone (γ)	Lumen	% Total
0-10°	370 lm	14.0%
10-20°	745 lm	28.1%
20-30°	871 lm	32.8%
30-40°	439 lm	16.5%
40-50°	113 lm	4.3%
50-60°	48 lm	1.8%
60-70°	33 lm	1.3%
70-80°	14 lm	0.5%
80-90°	5 lm	0.2%
90-100°	3 lm	0.1%
100-110°	3 lm	0.1%
110-120°	2 lm	0.1%
120-130°	2 lm	0.1%
130-140°	2 lm	0.1%
140-150°	2 lm	0.1%
150-160°	1 lm	0.0%
160-170°	1 lm	0.0%
170-180°	0 lm	0.0%
Total	2653 lm	100.0%

Intensity peaks

Max intensity	4144 cd
Intensity, 90°	2 cd
Intensity, 0°	4144 cd

Zonal Lumen summary


Zone (γ)	Lumen	% Total
0-30°	1986 lm	74.9%
0-40°	2425 lm	91.4%
0-60°	2586 lm	97.5%
60-90°	52 lm	2.0%
70-100°	21 lm	0.8%
90-120°	8 lm	0.3%
0-90°	2637 lm	99.4%
90-180°	16 lm	0.6%
0-180°	2653 lm	100.0%

BUG rating

	Lumen	% Total
Forward light		
Low(0-30°)	998 lm	37.6%
Medium(30-60°)	302 lm	11.4%
High(60-80°)	24 lm	0.9%
Very high(80-90°)	2 lm	0.1%
Back light		
Low(0-30°)	998 lm	37.6%
Medium(30-60°)	302 lm	11.4%
High(60-80°)	24 lm	0.9%
Very high(80-90°)	2 lm	0.1%
Uplight		
Low(90-100°)	0 lm	0.0%
High(100-180°)	0 lm	0.0%

IESNA TM-15-07
Luminaire Classification System
For Outdoor Luminaires

BUG rating B2 U1 G0

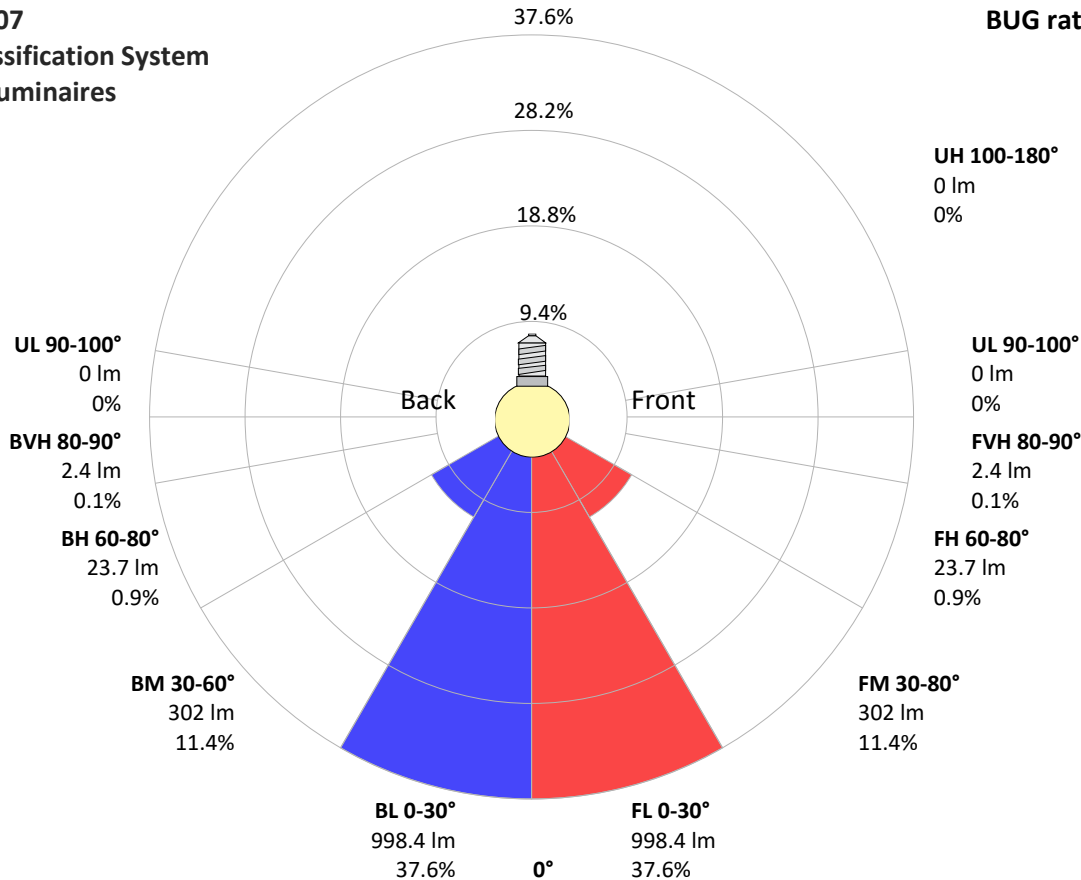

Goniophotometry Report

1_PHOT_REFLEKTER-L-4300lmChip-3000K-58Deg-ConcentricLouvre_2303
www.factorylux.com




Power Details

Input Power

Power feed to light source	41.4 W
Frequency of input power	50 Hz
RMS Input voltage feed, V_{RMS}	238 V
RMS Input current feed, I_{RMS}	0.180 A
Volt-Ampere or apparent power = $V_{RMS} \cdot I_{RMS}$	42.75 VA
Displacement factor of AC power feed	0.97
Power factor of AC current feed	0.97
Total harmonic distortion of the current	10.66%
Total harmonic distortion of the voltage	1.11%

Input Power Curve

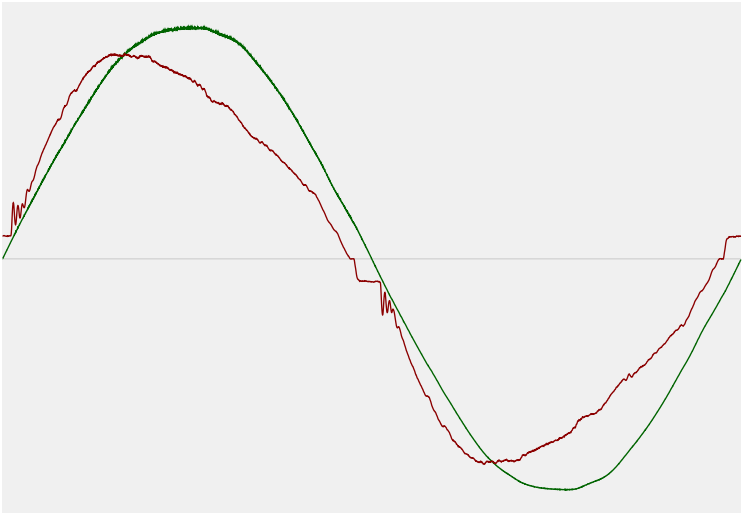

Efficiency

Radiated power efficiency	23.3%
Lumen efficiency	64 lm/W

Goniophotometry Report

1_PHOT_REFLEKTER-L-4300lmChip-3000K-58Deg-ConcentricLouvre_2303
www.factorylux.com




Color Measurements

Correlated Color Temperature CCT = 3000 K

Color Rendering TM30-18 R_f 91.0 — R_g 97.7

Color Shift, CIE duv Duv ±0.0003

Spectral distribution

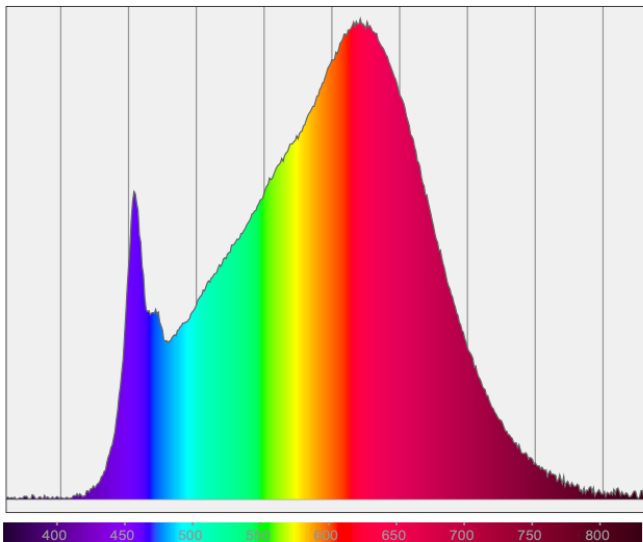

Color details

Correlated Color Temperature	CCT = 3000 K	Color coordinates CIE 1931	(x;y) = (0.437;0.404)
Color Rendering Index	CRI 94.1	Color coordinate CIEs 1960	(u;v) = (0.251;0.348)
Color Rendering Index, R9 (red component)	R9 = 68.6	Color deviation from BBL	Duv = ±0.0003
Color Rendering TM30-18	R _f 91.0 — R _g 97.7	Color coordinate CIEs 1976 (CIELUV)	(u';v') = (0.251;0.251)
Color Quality Scale	CQS = 91.8		

Goniophotometry Report

1_PHOT_REFLEKTER-L-4300lmChip-3000K-58Deg-ConcentricLouvre_2303
www.factorylux.com




CIE 1931



CIE 1931 – zoomed on Planckian locus




Color Rendering Index per reference color (CIE 1995)

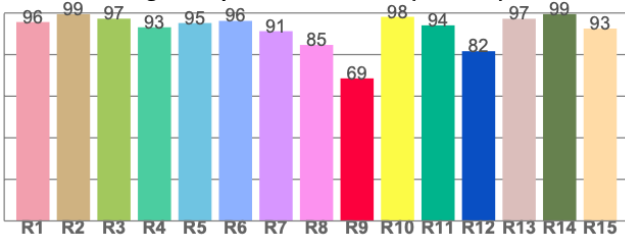


CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
95.7	99.5	97.3	93.1	95.2	96.2	91.3	84.6	68.6	98.2	94.1	81.6	97.2	99.5	92.5

Spectral power distribution (SPD) / W/nm – 0-100%

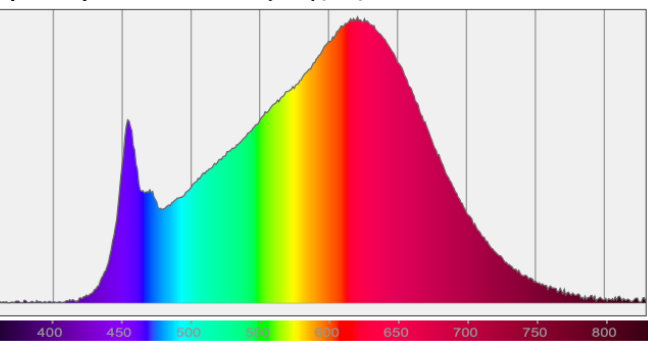


TM30-18 Rf-values per hue bin

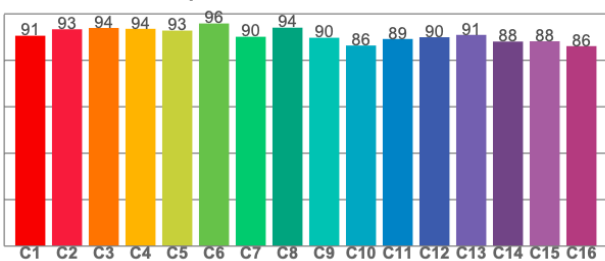

TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
90.6	93.4	93.9	93.6	92.8	95.9	90.1	94.0	89.7	86.4	89.2	89.9	90.9	88.1	88.2	86.1

Color Quality Scale by reference color

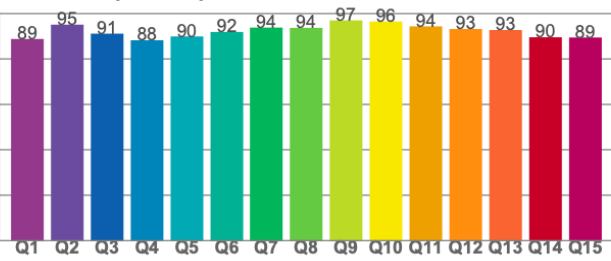

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
88.8	95.1	91.2	88.2	89.9	91.9	93.8	93.7	97.0	96.5	94.4	93.2	92.8	89.6	89.5